

NOTES - TO ENSURE NEMA 4 WATER PROTECTION

1. IN-WALL SS H310 HOUSING BOX MUST BE INSTALLED FLUSH TO WALL SURFACE.
2. INSTALL CLEAR ACRYLIC PANEL WITH GASKET FLUSH TO IN-WALL SS H310 BOX HOUSING.
3. INSTALL RED BAZEL WITH GASKET FLUSH TO CLEAR ACRYLIC PANEL.
4. ANY MOUNTING HOLES CREATED IN SS H310 HOUSING BOX MUST BE SEALED FROM WATER INGRESS.
5. DO NOT MAKE MOUNTING HOLES IN THE TOP OF SS H310 HOUSING BOX.
6. CONDUIT ENTRY RECOMMENDED AT BOTTOM OF UNIT.

DATE	SYM	REVISION RECORD	DR.	APP.
03-06-26	C	CHANGED DIM'S FOR ACRYLIC PANEL	ER	
09-15-25	B	RENAMED TO 947262	ER	
06-30-25	A	CHANGED DIM'S FOR ACRYLIC PANEL	ER	
01-22-25	X4	CHANGED THK. TO 0.354"	ER	
12-30-24	X3	CHANGED THK. TO 0.40"	ER	
12-18-24	X2	CHANGED DIM'S, NOTES	ER	
11-14-24	X1	PRELIMINARY RELEASE	ER	

TOLERANCES

.X	= ± .020
.XX	= ± .010
.XXX	= ± .005
XX"	= X. _"




Windsor, NJ


APPROVALS	DATE	TITLE
ER	11-14-24	OVERALL DIMENSIONS AND INSTALLATION, H310_310NL_LED

CHECKED:	APPVD:	SCALE	SIZE	TYPE	DWG NO.	REV
		NTS	D	F	947262_111424	C

SHEET 1 OF 2

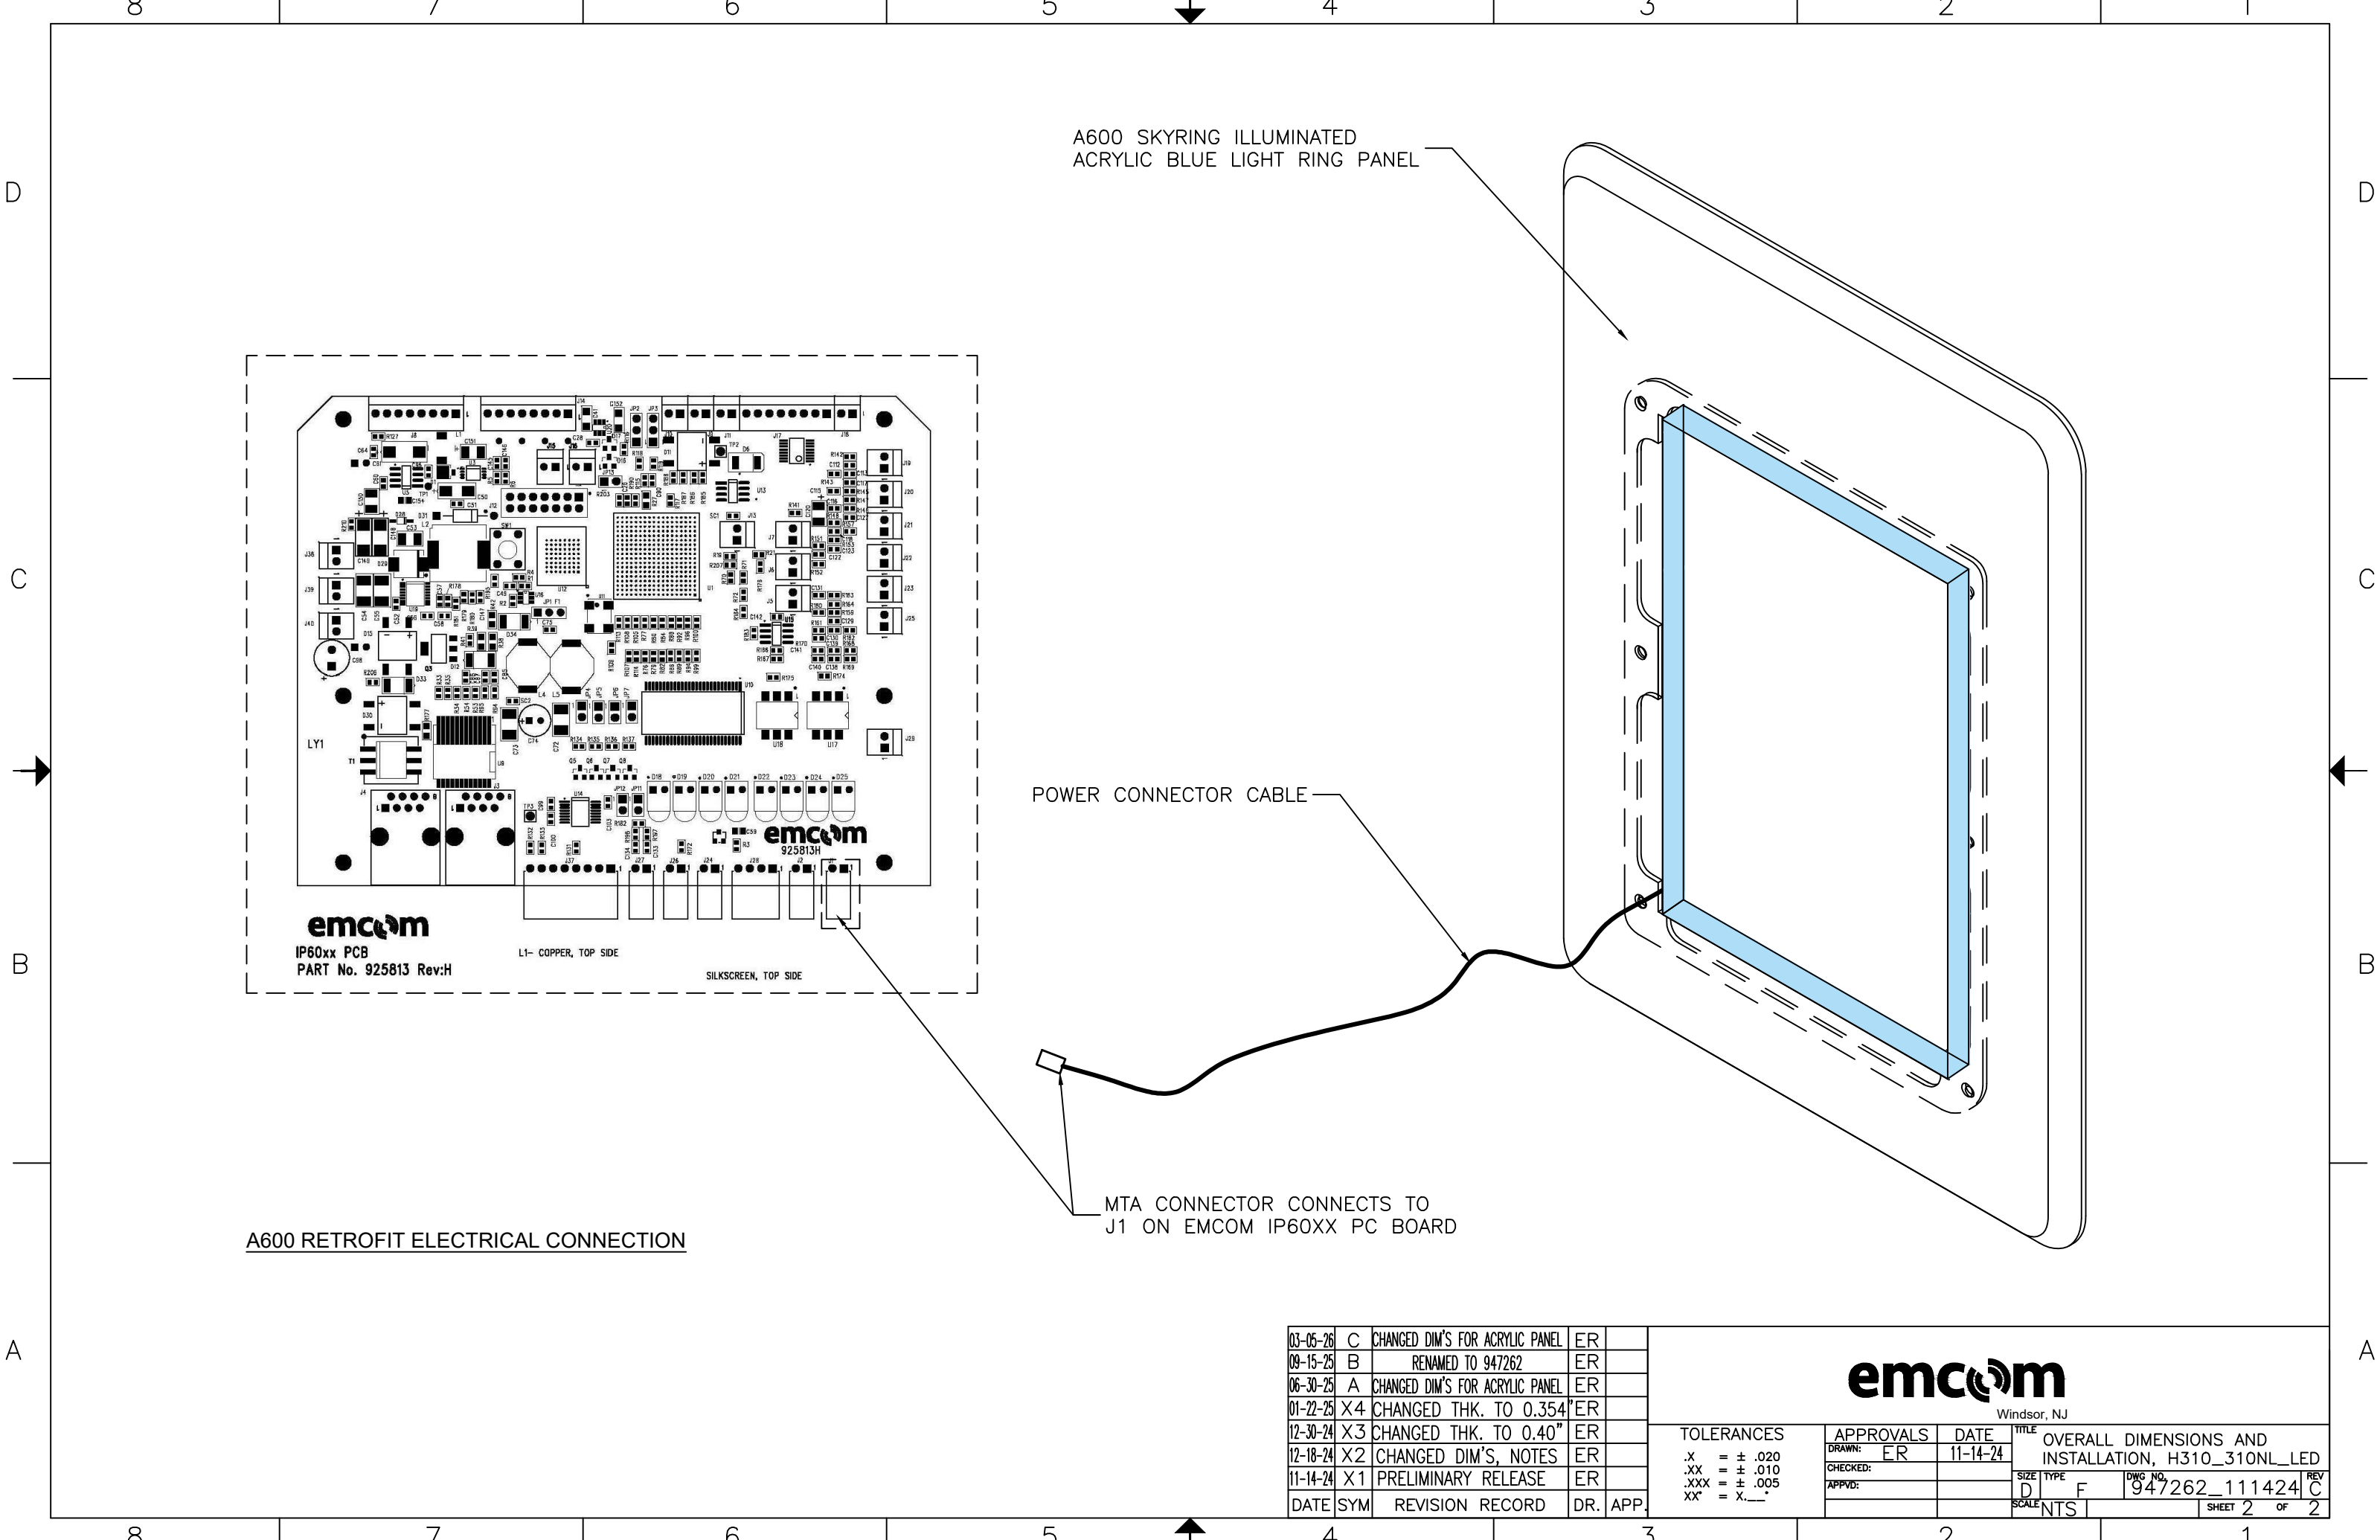

A600 SKYRING ILLUMINATED
ACRYLIC BLUE LIGHT RING PANEL

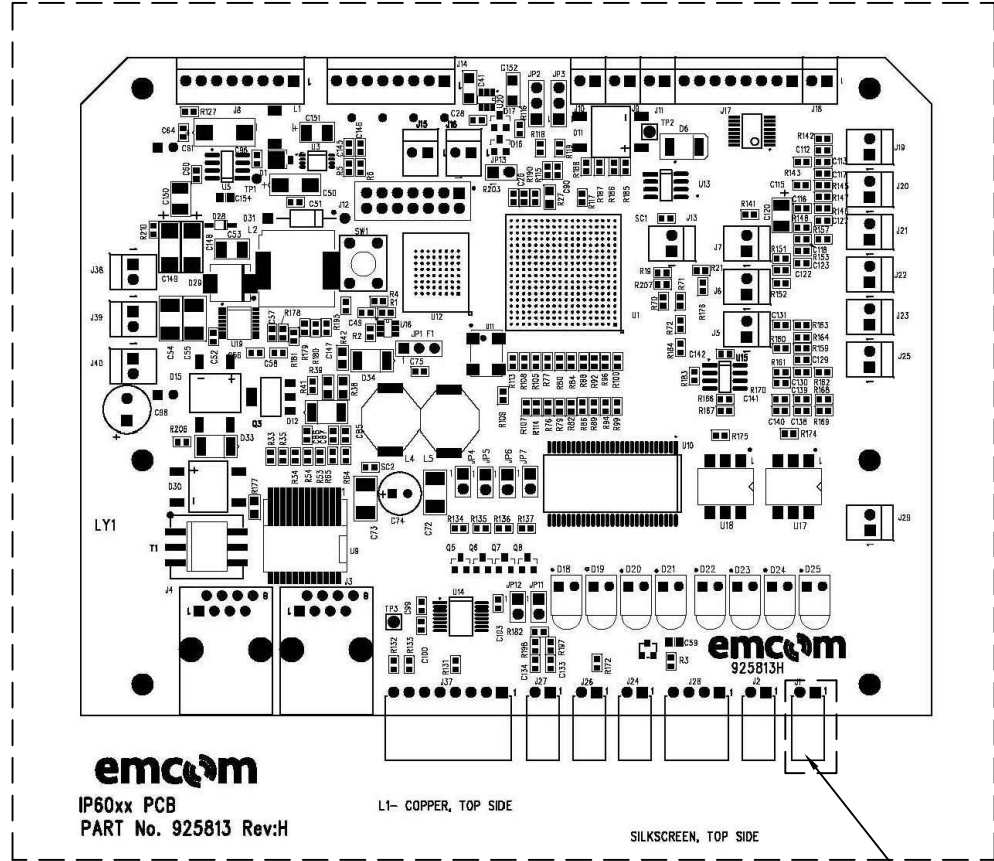

POWER CONNECTOR CABLE

MTA CONNECTOR CONNECTS TO
J1 ON EMCOM IP60XX PC BOARD

A600 RETROFIT ELECTRICAL CONNECTION

DATE	SYM	REVISION RECORD	DR.	APP.
03-05-26	C	CHANGED DIM'S FOR ACRYLIC PANEL	ER	
09-15-25	B	RENAMED TO 947262	ER	
06-30-25	A	CHANGED DIM'S FOR ACRYLIC PANEL	ER	
01-22-25	X4	CHANGED THK. TO 0.354"	ER	
12-30-24	X3	CHANGED THK. TO 0.40"	ER	
12-18-24	X2	CHANGED DIM'S, NOTES	ER	
11-14-24	X1	PRELIMINARY RELEASE	ER	

TOLERANCES
.X = ± .020
.XX = ± .010
.XXX = ± .005
XX* = X.---

emcom
Windsor, NJ

APPROVALS	DATE	TITLE
DRAWN: ER	11-14-24	OVERALL DIMENSIONS AND INSTALLATION, H310_310NL_LED
CHECKED:		SIZE TYPE DWG NO. REV
APPVD:		D F 947262_111424 C
		SCALE NTS SHEET 2 OF 2